


REFER TO DRAWING 201-101 FOR
LOCATION OF TERMINATING POINTS

REFER TO ASSEMBLY DRAWING 500-171
(MASTER) 500-181 (ANNUNCIATOR) FOR
LOCATION OF TERMINATING POINTS

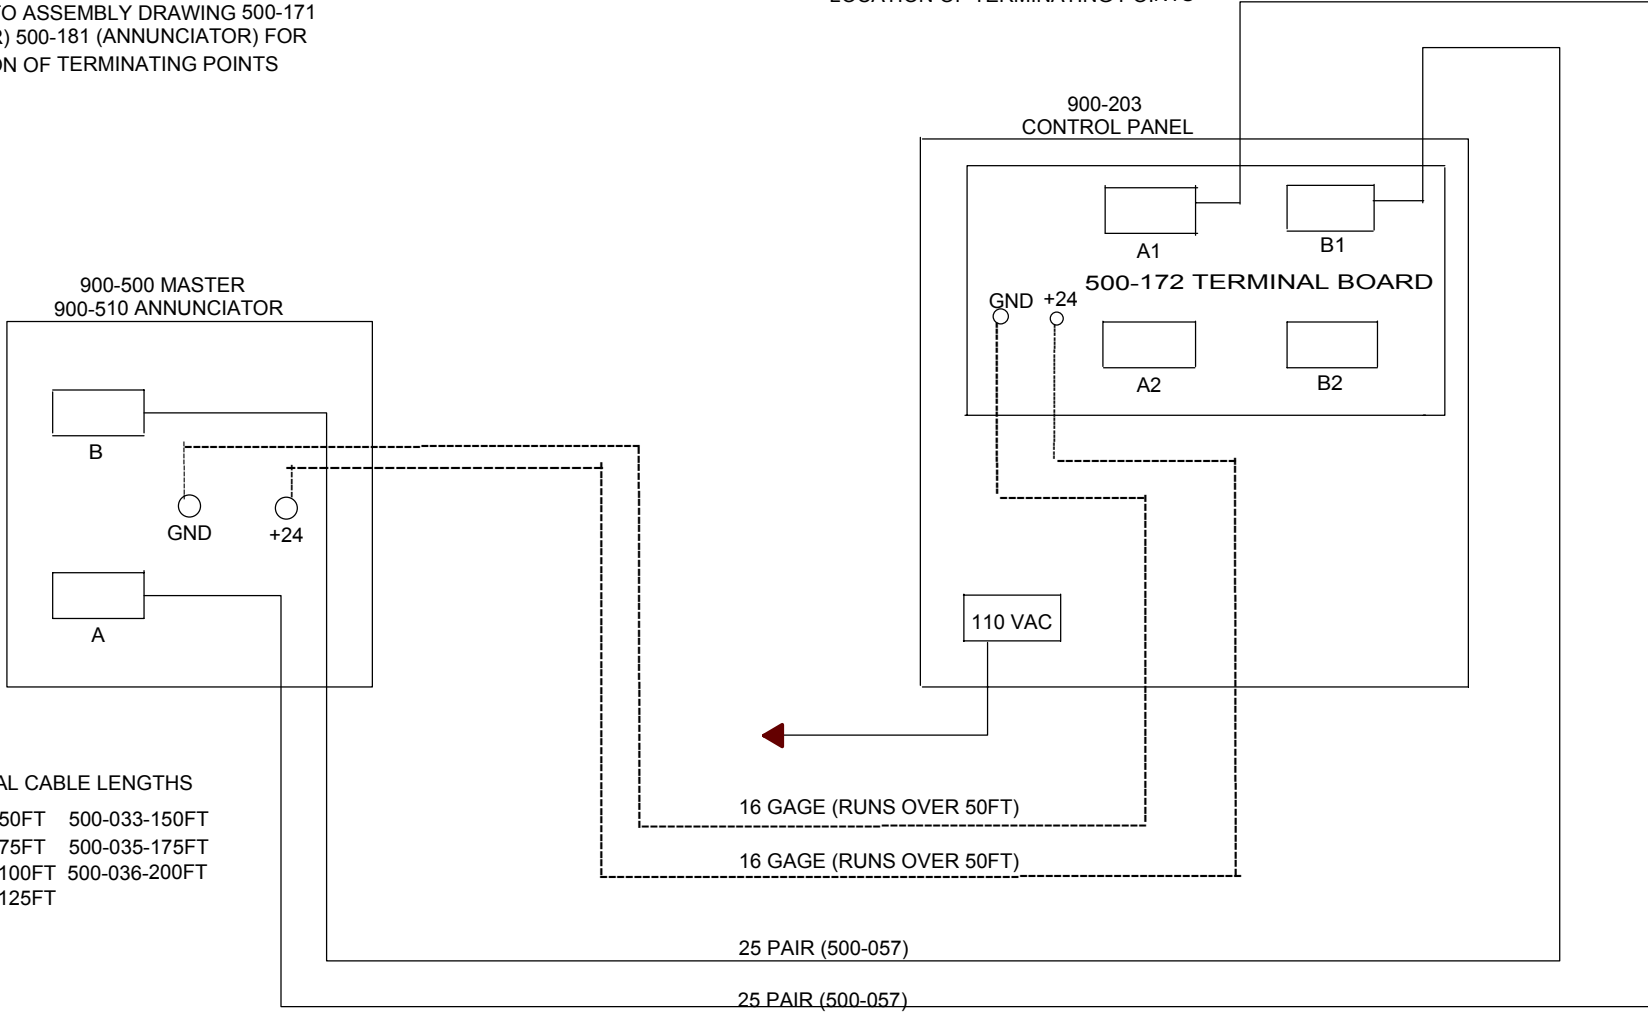

OPTIONAL CABLE LENGTHS
 500-027-50FT 500-033-150FT
 500-028-75FT 500-035-175FT
 500-029-100FT 500-036-200FT
 500-030-125FT

- NOTES!
- 110 VAC POWER FEED MUST COME IN BOTTOM LEFT OF CONTROL CABINET
 - ALL FIELD WIRING SHOULD COME IN TOP OF CONTROL CABINET
 - MINIMUM OF 1 1/4 INCH CONDUIT REQUIRED BETWEEN MASTER / ANNUNCIATOR AND CONTROL
 - TWO (2) CONDUCTOR 16 GAGE REQUIRED FOR RUNS OVER 50FT

TWO (2) 500-057 INTERCONNECT CABLES 25FT LONG ARE SUPPLIED WITH MASTER/ANNUNCIATOR
SEE OPTIONAL CABLES FOR DIFFERENT LENGTHS

Engineered Electronics, Inc 4301 Industrial Access Road Douglasville, Ga. 30134			
TITLE CABLE WIRING BETWEEN MASTER / ANNUNCIATOR AND CONTROL			
SIZE A		DRAWING NO. 102-007	REV
SCALE	DATE	4-10-02	